

STAIR REQUIREMENTS

Stairs, stair stringers, and stair guard shall meet the requirements shown in FIGURE 29 through FIGURE 36. All stringers shall be 2x12. Stair stringers shall not span more than the dimensions shown in FIGURE 30. If the stringer span exceeds these dimensions, then an intermediate landing will be required. All intermediate stair landings must be designed and constructed as a free-standing deck using the details in this package.

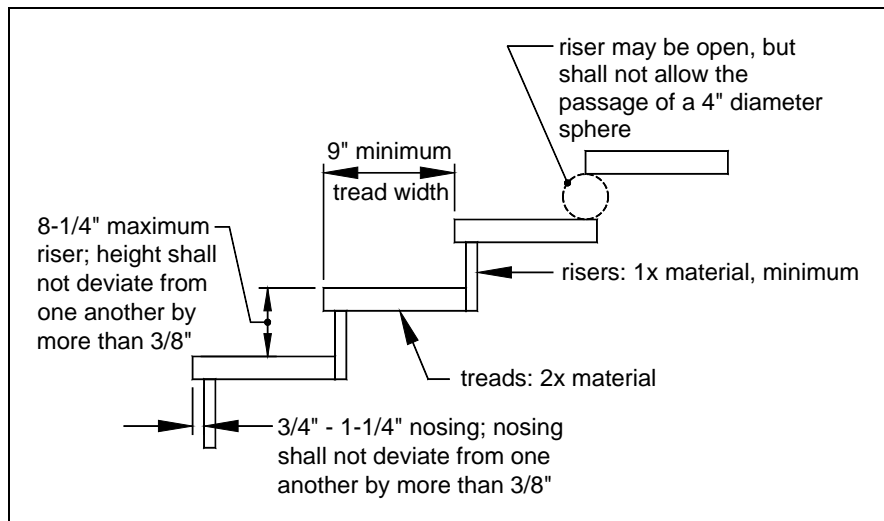


FIGURE 29: TREAD AND RISER DETAIL

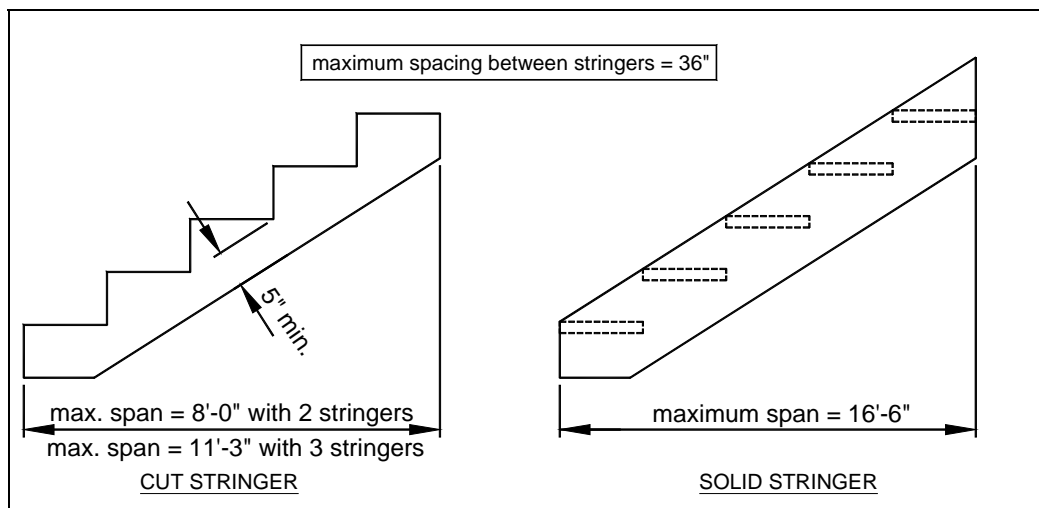


FIGURE 30: STAIR STRINGER REQUIREMENTS

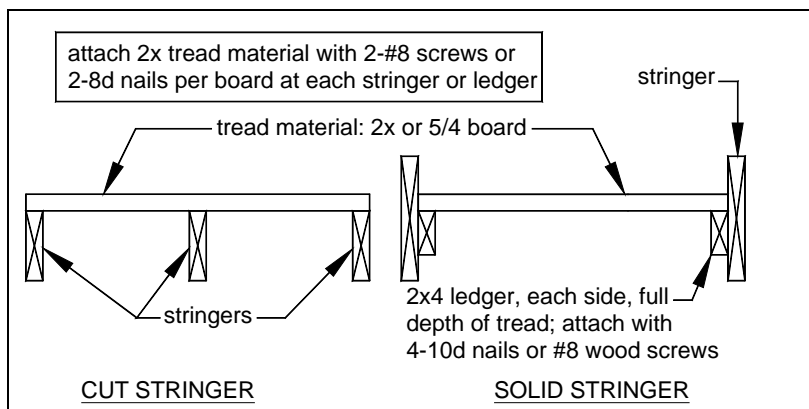


FIGURE 31: TREAD CONNECTION REQUIREMENTS



**Fairfax County
VIRGINIA**

Typical Deck Details

Based on the 2003 Virginia Uniform
Statewide Building Code

www.fairfaxcounty.gov/decks

Version: 2003.1, revised: 11/8/05

Sheet 15 of 18